



# SHRIRAM INSTITUTE FOR INDUSTRIAL RESEARCH

(A unit of Shriram Scientific and Industrial Research Foundation)

An ISO - 9001:2008 Certified Institute

## TEST CERTIFICATE

000193453

**Issued to :**

R.K. MARBLE PVT. LTD.,  
MAKRANA ROAD,  
MADANGANJ,  
KISHANGARH  
305801,

Kind Attn: MR. VIVEK MITRA , MANAGER (MARKETING)

**Sample Particulars:**

One sample described as Marble- R.K. BEIGE , Origin:- Turkey; was received.

J.O.No. 101-181-0970-F  
Reg.No. 1314090  
Date 04-02-2011  
GC-01 (REV-04)  
Your Ref.No. RK/SM-304/20

Date 20.12.2010

(Revised report of report no. 191796 dt. 19.01.2011)

(The sampling has not been done by Shri Ram Institute for Industrial Research. The sample details provided in test certificate are based on declaration by the party.)


### TEST RESULTS

S.No.	Test	Test value	Protocol Used
1.	<u>Chemical analysis (% By mass)</u>		ASTM C-25 & ICP-OES
a)	Loss on ignition (at 950±20°C)	42.8	
b)	Silica (as SiO <sub>2</sub> )	1.4	
c)	Alumina (as Al <sub>2</sub> O <sub>3</sub> )	0.2	
d)	Iron (as Fe <sub>2</sub> O <sub>3</sub> )	0.1	
e)	Lime (as CaO)	53.5	
f)	Magnesia (as MgO)	1.0	
g)	Soda (as Na <sub>2</sub> O)	0.09	
h)	Potash (as K <sub>2</sub> O)	0.02	
i)	Phosphorous (as P <sub>2</sub> O <sub>5</sub> )	0.04	
j)	Titania (as TiO <sub>2</sub> )	0.01	

\*\*\*\*\*

J.O.R.: 12.01.2011

D.O.C.: 18.01.2011

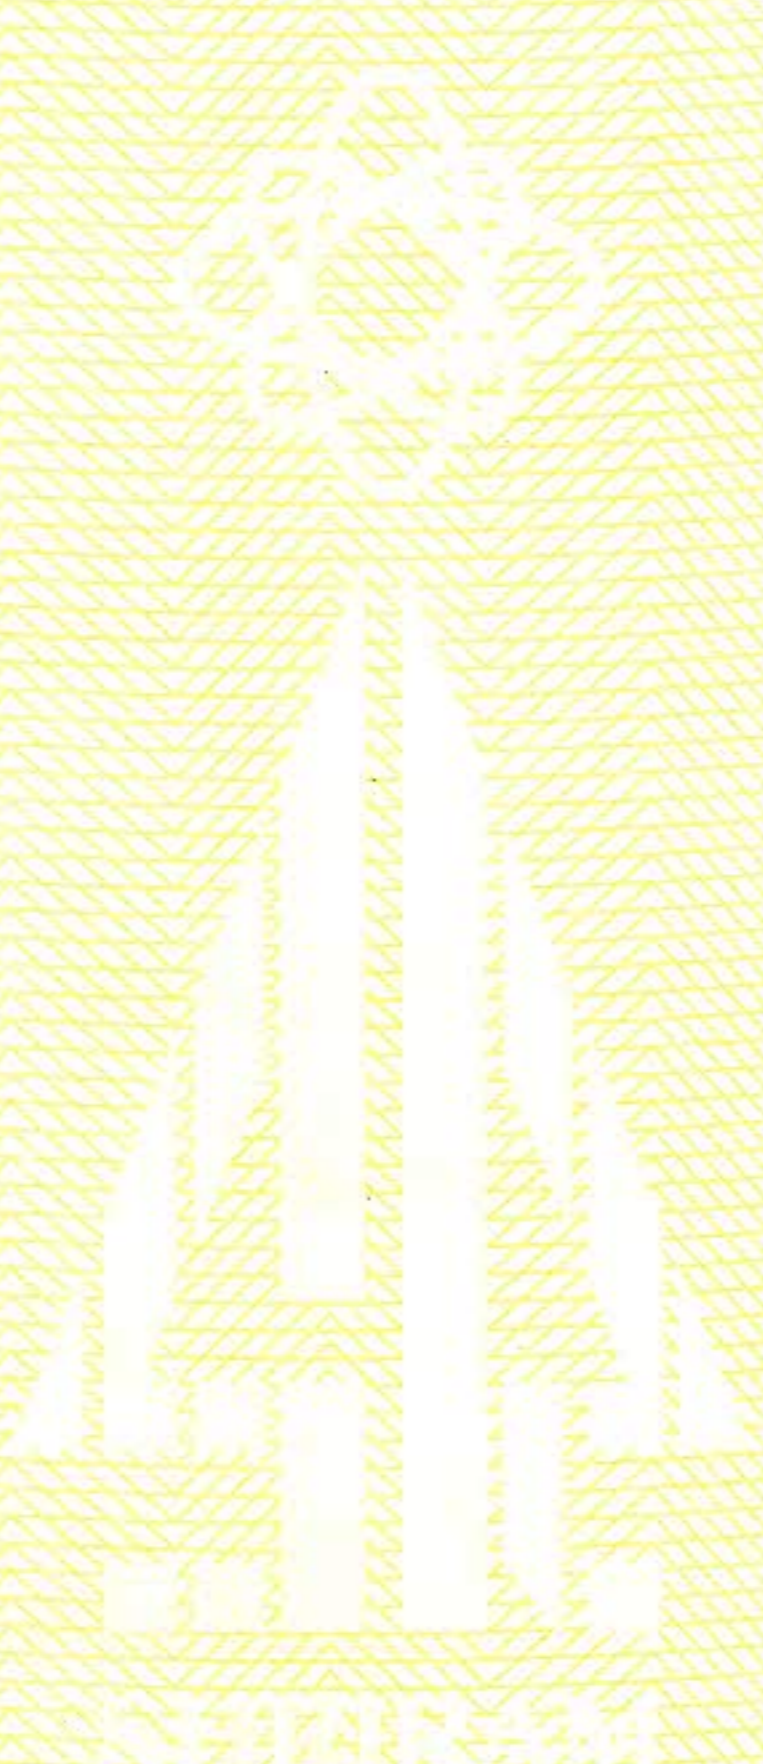

*PK Bhatnag*  
AUTHORISED SIGNATORY  
(EMPLOYEE CODE 4.4)

